



## WASTEWATER DEPARTMENT

812-285-6451 OFFICE  
812-285-6454 FAX

423 LEWMAN WAY  
JEFFERSONVILLE, INDIANA 47130

MIKE MOORE  
MAYOR


LEN ASHACK  
DIRECTOR

### REQUIREMENTS FOR GRAVITY SEWER PIPE (LATERAL) INSTALLATION ARE AS FOLLOWS:

- All pipe installed must be SDR 35 (ASTM 3034) or heavier;
- For single-family dwellings, the Owner must install a minimum of four-inch O-ring pipe, however the Inspector may accept four-inch glue joint pipe at his/her sole discretion;
- For structures larger than a single-family dwelling and for all commercial and industrial development, the Owner must install a minimum of six-inch O-ring pipe, however the Inspector may accept six-inch glue joint pipe at his/her sole discretion;
- In all structures, Owners must install two cleanouts, one near the building and one in the property line, and a backwater valve conforming to the requirements of the most recent edition of the Construction Standards as adopted by the Jeffersonville Sanitary Sewer Board;
- The backwater valve must be located and installed so that its working parts will be readily accessible for service and repairs. The backwater valve must be placed upstream of the required cleanouts.
- The backwater valve must be installed three (3) foot from the building and a cleanout must be installed downstream of the backwater valve. A second cleanout must be installed in either the easement or property line near the point where the building's lateral line connects to the City's sewer main. The cleanout at the property line shall be a minimum of six (6) inches.

#### Pipe bedding and backfill.

The lateral must be bedded on four (4) inches and covered by twelve (12) inches of Indiana No. 8 limestone.

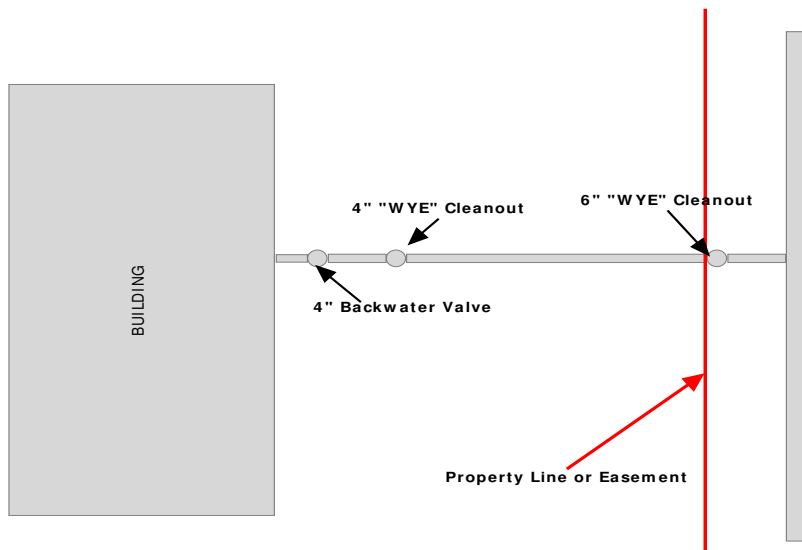

**AN EQUAL OPPORTUNITY EMPLOYER.**