



## WASTEWATER DEPARTMENT

812-285-6451 OFFICE  
812-285-6454 FAX

423 LEWMAN WAY  
JEFFERSONVILLE, INDIANA 47130


LEN ASHACK  
DIRECTOR

**REQUIREMENTS FOR GRAVITY SEWER PIPE (LATERAL) INSTALLATION ARE AS FOLLOWS:**

- All pipe installed must be SDR 35 (ASTM 3034) or heavier;
- For single-family dwellings, the Owner must install a minimum of four-inch O-ring pipe, however the Inspector may accept four-inch glue joint pipe at his/her sole discretion;
- For structures larger than a single-family dwelling and for all commercial and industrial development, the Owner must install a minimum of six-inch O-ring pipe, however the Inspector may accept six-inch glue joint pipe at his/her sole discretion;
- In all structures, Owners must install two cleanouts, one near the structure and one in the easement at the road, and a backwater valve conforming to the requirements of the latest Construction Standards as adopted by the Jeffersonville Sanitary Sewer Board;
- The backwater valve must be located and installed so that its working parts will be readily accessible for service and repairs. The backwater valve must be placed at the property line.
- The cleanout nearest the structure must be the same size as the building Owner's sewer line. The a cleanout must be installed three (3) feet from the building.

Pipe bedding and backfill.

**The lateral must be bedded on four (4) inches and covered by twelve (12) inches of Indiana No. 8 limestone.**

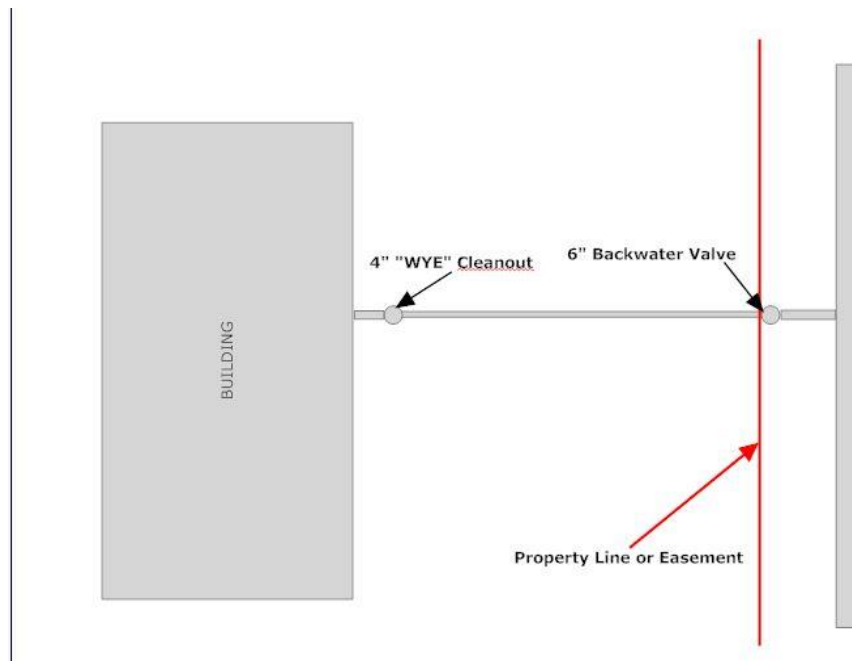

**AN EQUAL OPPORTUNITY EMPLOYER.**